

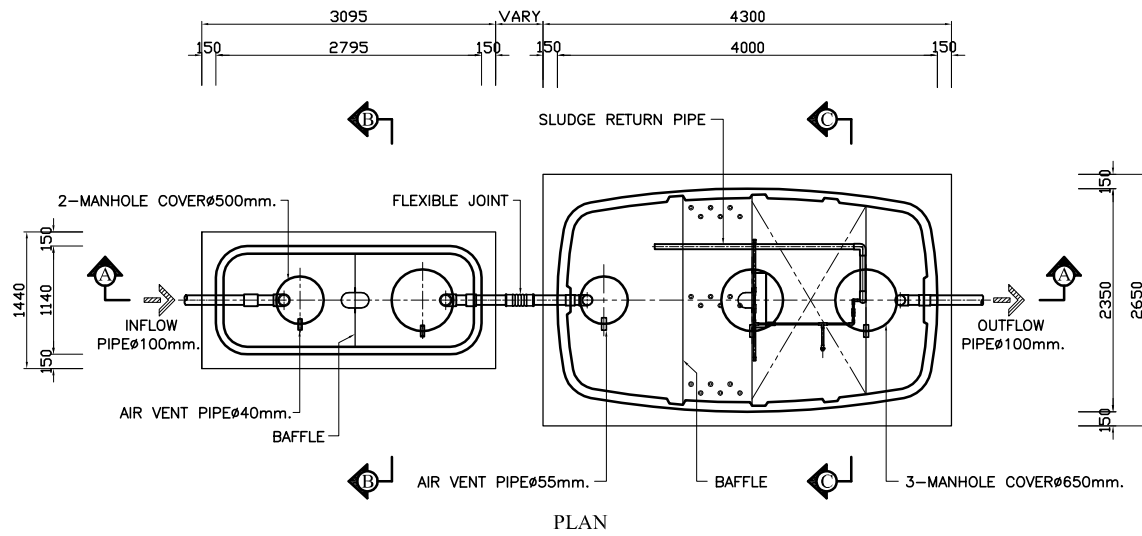


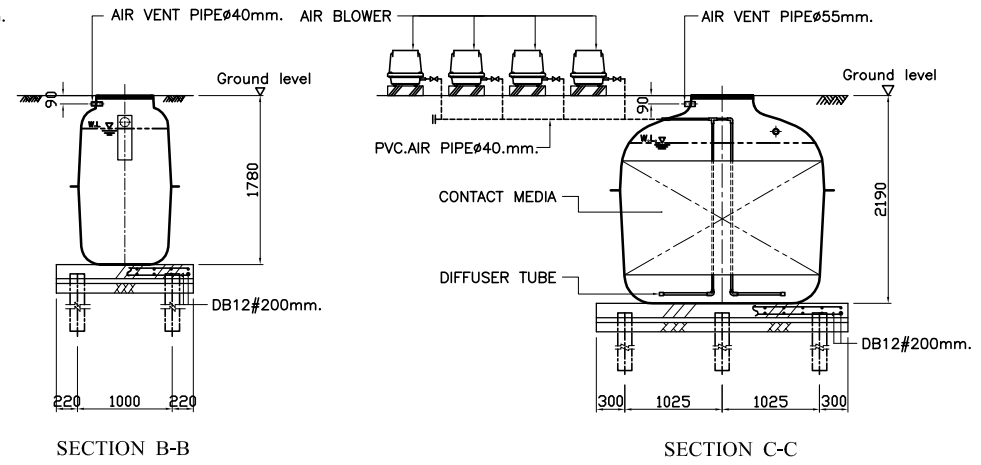

SPECIFICATION TABLE		
No.	ITEM	CONTENT
1	CAPACITY	
	1.1 GREASE SEPARATION CHAMBER	3.131 m ³
	1.2 PRIMARY SEDIMENTATION CHAMBER	3.557 m ³
	1.3 ANAEROBIC FILTRATION CHAMBER	2.235 m ³
	1.4 CONTACT AERATION CHAMBER	3.841 m ³
	1.5 SECONDARY SEDIMENTATION CHAMBER	1.195 m ³
	TOTAL	13.959 m ³
2	MATERIAL	
	2.1 CHAMBER	FRP
	2.2 SEPARATION PLATE , BAFFLE	FRP
	2.3 FILTER , CONTACT MEDIA	PE , PVC
	2.4 DIFFUSER TUBE	PVC
	2.5 MANHOLE COVER	ABS
	2.6 INFLOW , OUTFLOW PIPE	PVC(ϕ 100mm.)
3	EQUIPMENT	
	3.1 AIR BLOWER	100L/MIN (4UNIT)

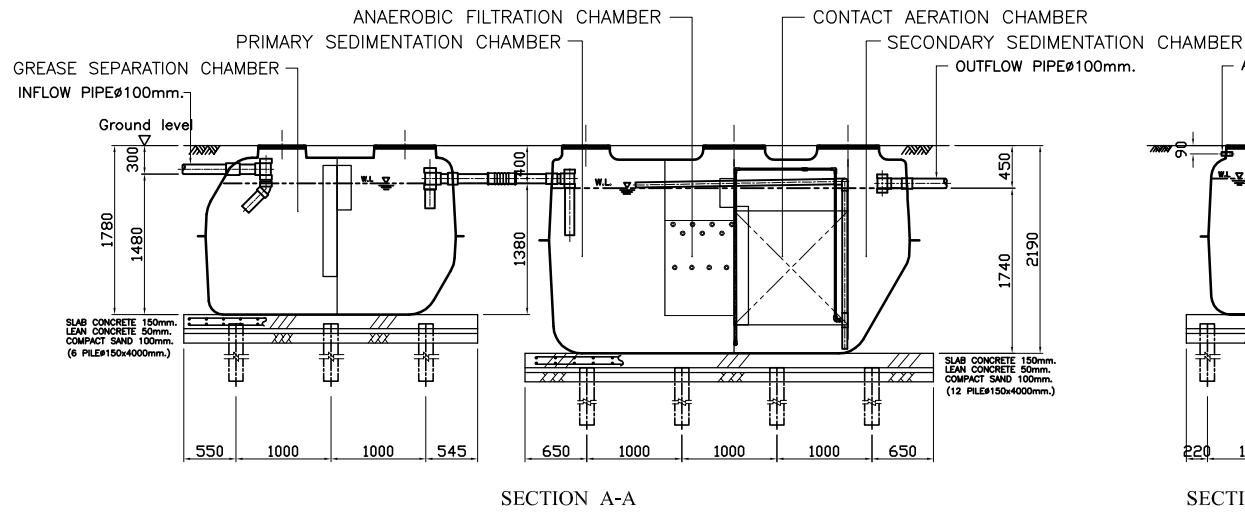

* REMARK : STRUCTURE DESIGN SHOULD BE RECOMMEND BY CIVIL ENGINEERS

Rev No.	Revision note	Date	Signature	Checked

CLEAN PRODUCTS CO.,LTD

บริษัท คลีน โปรดักส์ จำกัด

21/277 ปรินเมียมเพลส ถนนนวลจันทร์50 แขวงนวลจันทร์ เขตบึงกุ่ม กทม. 10230

Tel : (02)363-4107 Fax : (02) 363-4108

DWN		01 / 01 / 07	
CHECK	P.KAMOL		
APPD	P.KAMOL		

TITLE		Canteen Treatment
MODEL		CLEAN - 1100CT
PROJECT	Standard	REV.
DRAWING No.	-	SHEET No. 1/1

SCALE
1 : 60